

Instruction Manuel/Informative notice for 6/9L Water Stored Pressure Extinguisher.

EC Label certifies that :

- The extinguisher complies with the European pressure equipment directive (PED) n° 2014/68/EU.

**TRADE NAME REFERENCE**

GT006 EP / GT009 EP

EXTINGUISHER TYPE

6 or 9L extinguisher type contains water


FIRE RATING

(See class symbols on the extinguisher)



FIRES INVOLVING SOLIDS

The number before the letter in the top part of the marking indicates the fire rating classification and gives its efficiency. A high class number equal to a high efficiency. The operating temperatures limits indicated on the extinguisher must be respected.

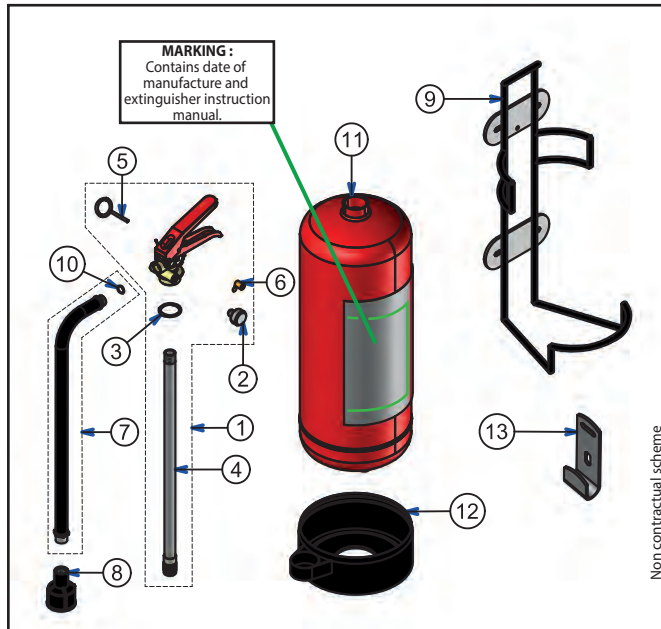

Non contractual scheme

EXTINGUISHER SCHEMA

- 1 - Assembled head
- 2 - Pressure gauge
- 3 - Cap O-Ring
- 4 - Dip tube
- 5 - Safety pin

- 6 - Plastic seal
- 7 - Complete hose
- 8 - Spray nozzle
- 9 - Transport bracket
- 10 - Hose O-Ring

- 11 - Cylinder
- 12 - Base
- 13 - Wall bracket

Heads are sold complete

STORAGE-INSTALLATION

After unpacking, all components must be in the box. Mainly, Complete Hose 7 and its Spray Nozzle 8 mounted on the outlet side of the Valve 1. The extinguisher must be installed vertically on its own wall bracket. Transport bracket (optional) is delivered with the extinguisher and can not be changed and not modified. The installation must be done by qualified staff. Stored in good temperature conditions in accordance with the temperatures limits of use.

USE

An extinguisher is a pressurized equipment. Only used on an outbreak of fire.
Read closely the notice. Always aim at the bottom of the flames.

VERIFICATION-MAINTENANCE

Recommendation : - Control annually the device and its weight.

To ensure its proper functioning : - Check if plastic seal is in place and undamaged.

If the plastic seal is broken or/and the extinguisher is under pressure, contact your agency which will ensure its maintenance and will answer further information. Only use products and spare parts that comply with the certified model for maintenance and refilling by qualified staff.

GLOBAL SPECIFICS CAUTIONS, SECURITY AND ENVIRONMENTAL

Limits of use are clearly specified on the extinguisher cylinder.

Check if the extinguisher is adapted to the fire rating.

Check which way the wind is blowing to avoid product projection during external use.

Do not modify the extinguisher by welding or brazing.

Keep clean : - No strong cleaning agent only damp cloth.

No external damaged, do not open.

Person-related safety precautions : - Wear goggles and face protection.

Environmental protection : - Do no disperse in the environment.

Reprocessing : - Give the inert material to an approved eliminator.

For those operations, it is recommended to use qualified staff.