

Intruction Manuel/Informative notice for Automatic extinguisher :

- 9 and 12 kg Powder Extinguisher with cartridge.
- 9 and 12 L FOAM Extinguisher with cartridge.



EC Label certifies that :

- The extinguisher complies with the European pressure equipment directive (PED) n° 2014/68/EU.

TRADE NAME REFERENCE

GSP009 ABC / AC - GSP009 BC / AC
 GSP0012 ABC / AC - GSP0012 BC / AC
 GSP009 EPA / AC - GSPA009 EPA AC
 GSP0012 EPA / AC - GSPA0012 EPA / AC

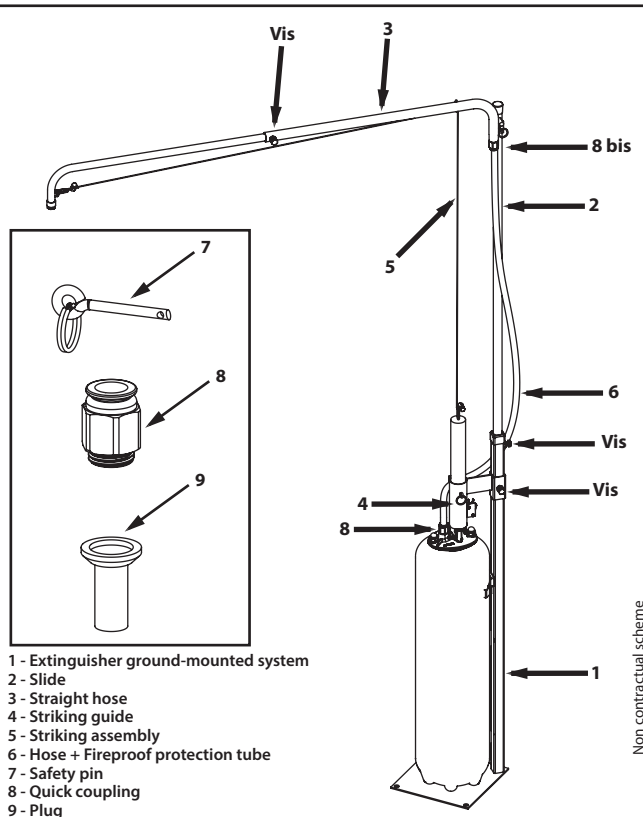
EXTINGUISHER TYPE

9 or 12 KG Automatic extinguisher
 type contains ABC or BC powder

9 or 12 L Automatic extinguisher
 type contains water with additive

FIRE RATING

(See class symbols on the extinguisher)

POWDER :**WATER :**

DO NOT USE ON GAZ FLAM

VERIFICATION-MAINTENANCE

Recommendation :

- Control annually the device and its weight.

To ensure its proper functioning : - Check if the hose is in place and undamaged.

If the hose is broken or/and the extinguisher is under pressure, contact your agency which will ensure its maintenance and will answer further information. Only use products and spare parts that comply with the certified model for maintenance and refilling by qualified staff.

GLOBAL SPECIFICS CAUTIONS, SECURITY AND ENVIRONMENTAL

Limits of use are clearly specified on the extinguisher cylinder.

Check if the extinguisher is adapted to the fire rating.

Do not modify the extinguisher by welding or brazing.

Keep clean :

- No strong cleaning agent only damp cloth.

No external damaged, do not open.

Person-related safety precautions : - Wear goggles protection.

Environmental protection : - Do no disperse in the environment.

Reprocessing : - Give the inert material to an approved eliminator.

For those operations, it is recommended to use qualified staff.

Cleaning :

- Collect with vacuum cleaner or sweep the floor.
- Clean the floor with water, do not use cleaning agent (bleach for example).
- Do not throw in the sewers.

INFORMATION REGARDING ACTION TO BE TAKEN IN CASE OF ACCIDENTAL CONTACT WITH THE EXTINGUISHING AGENT

Do not eat foods which could have been in contact with the extinguishing agent.

FIRST AID MEASURES

In case of skin contact, eyes or in case of ingestion, seek medical advice with the MSDS of the product.

MSDS are available on request to the supplier.

STORAGE-INSTALLATION

After unpacking, all components must be in the box. The extinguisher must be installed vertically on its own wall bracket. The installation must be done by qualified staff. Stored in good temperature conditions in accordance with the temperatures limits of use.

USE

An extinguisher is a pressurized equipment. Only used for automatic model installations fire fighting action.

Read closely the notice.