

Instruction Manuel/Informative notice for 6/9L Water or Foam With cartridge Extinguisher.

EC Label certifies that :

- The extinguisher complies with the European pressure equipment directive (PED) n° 2014/68/EU.



NF Label certifies that :

- The European standard NF EN3-7 + A1 is respected.

- The product is in conformity with the requirements of the Certification Rules NF074 and in particular with the certified properties in accordance with the NF certified product list available on website <http://www.marque-nf.com/download/produits/FR/NF074.pdf>**TRADE NAME REFERENCE**

GS006 EPA - GSP006 EPA - GSPP006 EPA
 - GSPA006 - GS006 EPA BIO/BIOVERSAL 6 - GS006 EP
 - GS009 EPA - GSPP009 EPA - GSPA009
 - GS009 EPA BIO/BIOVERSAL 9 - GS009 EP

EXTINGUISHER TYPE


6 or 9L extinguisher type contains
 water or water with additive

FIRE RATING

(See class symbols on the extinguisher)



The number before the letter in the top part of the marking indicates the fire rating classification and gives its efficiency. A high class number equal to a high efficiency. The operating temperatures limits indicated on the extinguisher must be respected.

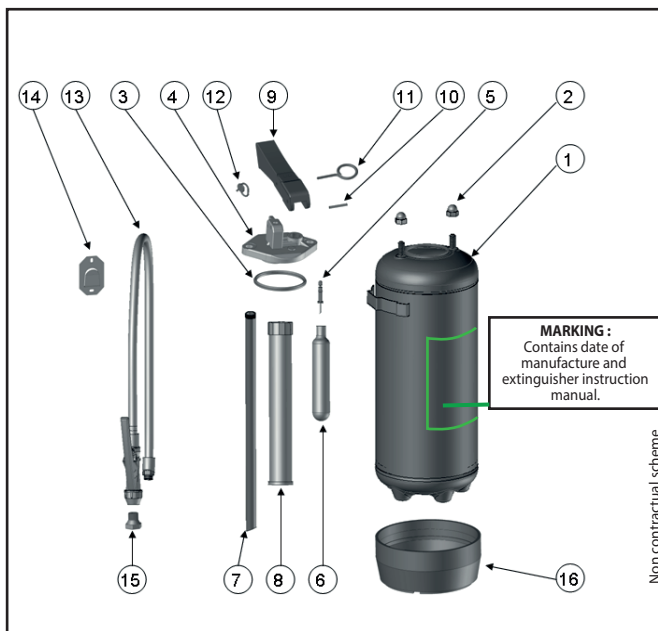

Non contractual scheme

EXTINGUISHER SCHEMA

- | | | |
|-------------------|-------------------------------|--|
| 1 - Cylinder | 8 - Container (with additive) | 15 - Spray nozzle |
| 2 - Nut | 9 - Lever | 16 - Base (Optional or if the device is placed on the floor) |
| 3 - Cap O-Ring | 10 - Hinge pin | |
| 4 - Head | 11 - Safety pin | |
| 5 - Striker | 12 - Plastic seal | |
| 6 - CO2 cartridge | 13 - Hose | |
| 7 - Dip tube | 14 - wall bracket | |

STORAGE-INSTALLATION

After unpacking, all components must be in the box. The extinguisher must be installed vertically on its own wall bracket. Transport bracket (optional) is delivered with the extinguisher and can not be changed and not modified. The installation must be done by qualified staff. Stored in good temperature conditions in accordance with the temperatures limits of use.

USE

An extinguisher is a pressurized equipment. Only used for fire fighting action.
 Read closely the notice. Always aim at the bottom of the flames.

VERIFICATION-MAINTENANCE

Recommendation : - Control annually the device and its weight.

To ensure its proper functioning : - Check if plastic seal is in place and undamaged.

If the plastic seal is broken or/and the extinguisher is under pressure, contact your agency which will ensure its maintenance and will answer further information. Only use products and spare parts that comply with the certified model for maintenance and refilling by qualified staff.

GLOBAL SPECIFICS CAUTIONS, SECURITY AND ENVIRONMENTAL

Limits of use are clearly specified on the extinguisher cylinder.

Check if the extinguisher is adapted to the fire rating.

Check which way the wind is blowing to avoid product projection during external use.

Do not modify the extinguisher by welding or brazing.

Keep clean : - No strong cleaning agent only damp cloth.

No external damaged, do not open.

Person-related safety precautions : - Wear goggles and face protection.

Environmental protection : - Do no disperse in the environment.

Reprocessing : - Give the inert material to an approved eliminator.

For those operations, it is recommended to use qualified staff.

Cleaning :

- Collect with vacuum cleaner or sweep the floor.

- Clean the floor with water, do not use cleaning agent (bleach for example).

- Do not throw in the sewers.

INFORMATION REGARDING ACTION TO BE TAKEN IN CASE OF ACCIDENTAL CONTACT WITH THE EXTINGUISHING AGENT

Do not eat foods which could have been in contact with the extinguishing agent.

FIRST AID MEASURES

In case of skin contact, eyes or in case of ingestion, seek medical advice with the MSDS of the product.

MSDS are available on request to the supplier.

Certification Body for the NF mark :**AFNOR Certification****11, rue Francis de Pressensé****93571 La Plaine Saint Denis Cedex, France****Telephone : +33 (0)1.41.62.80.00****Fax : +33 (0)1.49.17.90.00****Websites : <https://certification.afnor.org/qualite/nf-extincteurs>****Email : certification@afnor.org**

The mark awarded to extinguishers is a guarantee of consistent quality verified by a third party based on a network of professional expertise.

Through its rigorous and exhaustive inspections (holder's Quality Management System, product inspections, audits and monitoring tests, etc.), the NF mark represents a comprehensive guarantee for end users that the certified products are compliant.

The NF-EXTINGUISHERS mark confirms the product's compliance with certification guidelines NF 074.

For an extinguisher to achieve optimum performance over time, it should be installed correctly, checked and periodically serviced. It must be maintained in good working order in accordance with the standards and technical rules in force.